




## ATCO Gas Valve Replacement - Calgary

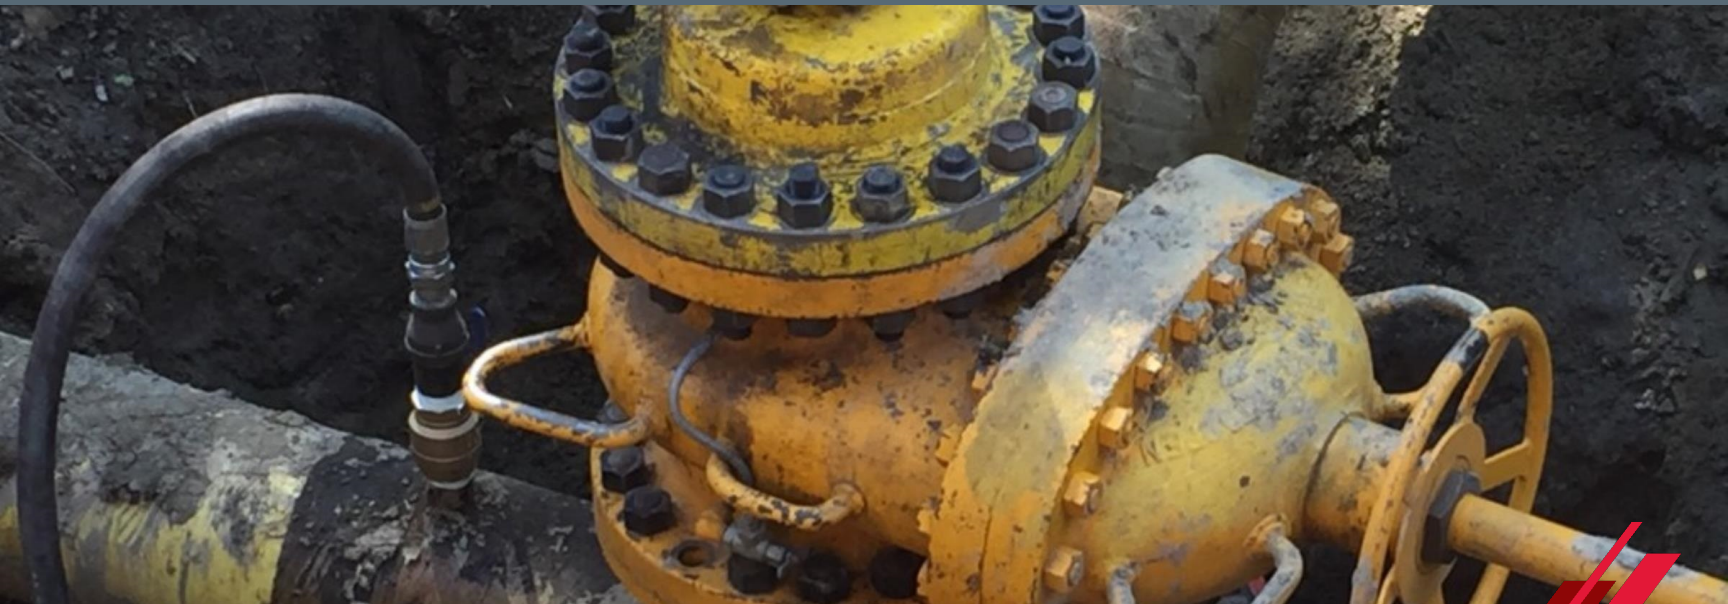

### PROJECT DESCRIPTION

Project is to remove an existing 6" steel valve located in a vault, and install a new PE valve in a new location. Line will be isolated utilizing two 6" Mueller stopper fittings and one 8" Mueller stopper fitting. Work location is on Memorial Drive NE, in a busy intersection.

#### Client

ATCO Gas

#### Job Number

17514

#### Work Type

Distribution Pipeline

#### Location

Alberta

#### Role

Prime Contractor

